



ABSOLUTE ROTARY ENCODER
ETHERCAT®



**Absolute Rotary Encoder
with EtherCAT® Interface**

xCx-ECxB-xxxx-xxxx-xxx



ABSOLUTE ROTARY ENCODER ETHERCAT®

Content

1	Safety Instructions.....	4	5.1	Function of LEDs for Ports	12
2	Introduction.....	5	5.2	Function of LEDs for EtherCAT® ..	12
2.1	General Definitions.....	5	6	Network Configuration.....	13
2.2	Intended Usage	5	6.1	Install Encoders to Network	13
2.3	Interfaces.....	5	7	Project Integration	14
2.4	Maintenance.....	5	7.1	ESI File.....	14
2.5	Intended Time of Usage	5	7.2	Configuration with TwinCAT® 2..	14
2.6	Optical Measurement Principle	5	7.3	Configuration with TwinCAT® 3..	25
2.7	Magnetical Measurement Principle	7	7.4	Diagnostic.....	34
2.8	Ethernet.....	8	8	Communication Profile	35
3	Hardware Set-Up and Ethernet		9	Encoder Profile	36
	Connection	9	10	Conformance Test	40
3.1	Network Topology.....	9	11	FAQ.....	41
4	Connection an Absolute Encoder	10	12	Glossary	42
4.1	Connector Ethernet EtherCAT® ...	10	13	Additional information	44
4.2	Connector Power Supply.....	10	14	History	45
4.3	Ethernet Cables	11			
5	Diagnostic LED's.....	12			

ABSOLUTE ROTARY ENCODER ETHERCAT®

General Security Advice

Important Information

Read these instructions carefully and look at the equipment to become familiar with the device before trying to install, operate, or maintain it. The following special messages may appear throughout this documentation or on the equipment to warn of potential hazards or to call attention to information that clarifies or simplifies a procedure.



The addition of this symbol to a Danger or Warning safety label indicates that an electrical hazard exists, which will result in personal injury if the instructions are not followed.



This is the safety alert symbol. It is used to alert you to potential personal injury hazards. Obey all safety messages that follow this symbol to avoid possible injury or death.

Please Note

Electrical equipment should be serviced only by qualified trained personnel. No responsibility is assumed by FRABA for any consequences arising out of the use of this material. This document is not intended as an instruction manual for untrained persons.

About this Manual

Trademark

EtherCAT® is registered trademark and patented technology, licensed by Beckhoff Automation GmbH, Germany.

Background

This user manual describes how to install and configure an Absolute Rotary Encoder with EtherCAT® interface. General technical data and mechanical drawings are specified in the document data sheet, which can be downloaded from the website: www.posital.eu

Relate Note

Version date: 9.1.2019
Version number: 1.5
Reference number: UME-xCx-EC
Author: Reiner Bätjer

Imprint

FRABA B.V.
Jan Campertstraat 11
NL-6416 SG Heerlen
T +49 (0) 221 96213-0, F +49 (0) 221 96213-20
www.fraba.com, info@fraba.com

Copyright

The company FRABA BV claims copyright on this documentation. It is not allowed to modify, to extend, to hand over to a third party and to copy this documentation without written approval by the company FRABA BV. Nor is any liability assumed for damages resulting from the use of the information contained herein. Further, this publication and features described herein are subject to change without notice.

User Annotation

The FRABA BV welcomes all reader to send us feedback and commands about this document. You can reach us by e-mail at info@posital.eu

**ABSOLUTE ROTARY ENCODER
ETHERCAT®****1 Safety Instructions**

Do not remove the connection cap!



The absolute rotary encoder must be connected to the main signal ground over the machine chassis or by means of a separate potential compensating line.



Do not stand on the encoder!



Do not adapt the driving shaft additionally!



Avoid mechanical load!



Do not adapt the housing additionally!



ABSOLUTE ROTARY ENCODER ETHERCAT®

2 Introduction

This manual explains how to install and configure the Absolute Rotary Encoder with EtherCAT® interface applicable for military and industrial applications with EtherCAT® protocol. The products

are compliant with standard DS406 (encoder device profile) and Ethernet ETHERCAT® Communication Profile Specification CiA DS 301 V1.1.0.

2.1 General Definitions

In the following chapters general definitions are described.

2.2 Intended Usage

The absolute rotary encoder measures the physical measure and angle and revolutions and converts this into a digital position value transmitted via the EtherCAT® bus according to the EtherCAT® communication profile (CiA DS301) to other field devices. The encoder shall be connected to an

EtherCAT® network according to (CiA DS301) and shall only be used for this purpose. The sensor can be used in applications like positioning tasks or length measurements. General applications could be like cranes, construction machines, lifts, packing machines etc.

2.3 Interfaces

The sensor has one EtherCAT® interface with incoming and outgoing port to support a daisy chain

cable structure and supports the profile Specification CiA DS 301 V1.1.0.

2.4 Maintenance

For the device is no maintenance necessary!

2.5 Intended Time of Usage

Refer to the data sheet of the Absolute Rotary Encoder.

2.6 Optical Measurement Principle


2.6.1 Overview

The absolute rotary encoders use highly integrated Opto-ASICs, providing a resolution up to 16 bits (65,536 steps) per turn. For multiturn models, the measuring range is extended by the mechanically

geared code disks to as many as 16,384 (2¹⁴) revolutions. These encoders are fully capable of operating in rugged industrial settings.

USER MANUAL
ABSOLUTE ROTARY ENCODER
ETHERCAT®

2.6.2 Singleturn

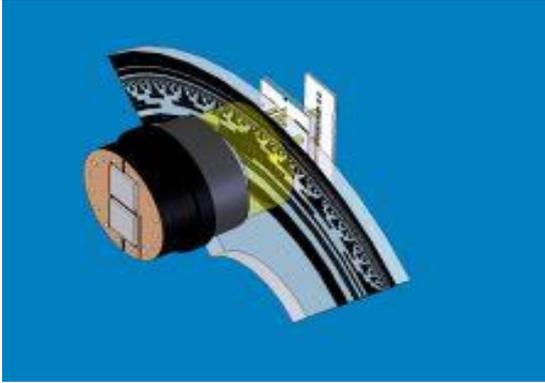

The measuring system in the single-turn module consists of a light source, a code disc pivoted in a precision ball bearing and an opto-electronic scanning device. A LED is used as a light source which shines through the code disc and onto the screen behind. The tracks on the code disc are

evaluated by an opto-array behind the reticle. With every position another combination of slashes in the reticle is covered by the dark spots on the code disk and the light beam on the photo transistor is interrupted. That way the code on the disc is transformed into electronic signals. Fluctuations in the intensity of the light source are measured by an additional photo transistor and another electronic circuit compensates for these.

After amplification and conversion the electronic signals are available for evaluation. Single turn encoders specify the absolute position for one turn of the shaft i.e. for 360°. After one turn the measuring range is completed and starts again from the beginning.

2.6.3 Multiturn



Linear systems normally need more than one turn of a shaft. A single turn encoder is unsuitable for this type of application because of the additional requirement of the number of turns. The principle is relatively simple: Several single turn encoders are

connected using a reduction gear. The first stage supplies the resolution per turn, the stages behind supply the number of turns. In the following picture you can see the gearing module with the several stages of reduction gears.

Typical Applications:

- Packing Machines
- Robots
- Printing Machines
- Theater / Moving Platforms

There are several types of encoder versions. Please refer to the datasheets to find out which is the best version for your application.

USER MANUAL
ABSOLUTE ROTARY ENCODER
ETHERCAT®

2.7 Magnetical Measurement Principle

2.7.1 Overview

Magnetic rotary encoders determine angular position using magnetic field sensor technology. A permanent magnet A fixed to the encoder's shaft creates a magnetic field which is sampled by a


sensor B that generates an accurate absolute position reading.

2.7.2 Singleturn

The technological leap that pushes POSITAL's IXARC magnetic encoders to the performance level of optical systems is based on a new generation of sensor systems. The combination of a custom Hall-effect sensor and complex signal processing

algorithms running on a powerful 32 bit microprocessor results in a considerably improved resolution and accuracy, along with latency times of only a few microseconds.

2.7.3 Multiturn

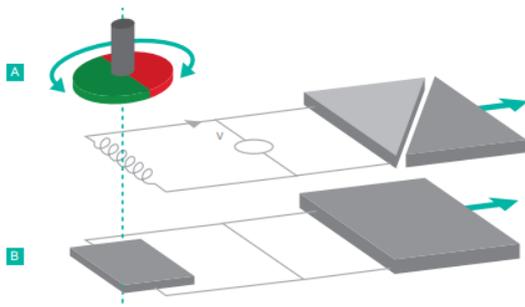

POSITAL can also provide absolute multiturn measurements by means of a revolution counter system that uses an energy harvesting system based on the Wiegand effect. This system requires no gears or batteries. Eliminating batteries brings about many advantages. Batteries have a limited lifespan, weigh a lot, and often contain harmful

substances. Gear units have disadvantages of their own being large, complex, costly and vulnerable to shock and vibration. Regardless of the rotational speed, even at near-zero, the energy harvesting system generates short, powerful voltage pulses, sufficient to power the counting electronics. The result is a revolution counter that is independent of any external power supply. This technology, which has proven itself since 2005, enables maintenance-free reliable measurement of absolute positions, even in demanding environments, for years to come.

There are several types of encoder versions. Please refer to the datasheets to find out which is the best version for your application.



ABSOLUTE ROTARY ENCODER ETHERCAT®

2.8 Ethernet

The present developments in the field of Industrial Ethernet are based on the vision of an integrated access of all data of a company through a uniform communication system. In higher levels of enterprise communication Ethernet is the main medium of data transfers. Combined with other IT technologies it is internationally standardized. In the long run automation engineers will benefit from the rapid technological progress in the mass markets of IT and web technologies.

Ethernet technically provides a system with higher data transfer rates than common field bus systems. TCP/IP and UDP do have a statistical access method to access the medium thereby prohibiting determined response times. Many developments are intensely done on additional real time mechanisms, e.g. EtherCAT®.

EtherCAT®'s key functional principle lies in how its nodes process Ethernet frames:

each node reads the data addressed to it and writes its data back to the frame all while the frame is moving downstream. This leads to improved bandwidth utilization (one frame per cycle is often sufficient for communication) while also eliminating the need for switches or hubs.

The unique way EtherCAT® process frames makes it the fastest Industrial Ethernet Technology; no other technology can top EtherCAT®'s bandwidth utilization or the corresponding performance.

In addition to its speed, an EtherCAT® network can support up to 65,535 devices without placing restrictions on their topology: line, bus, tree, star – or any combination thereof. Fast Ethernet Physics allows two devices to be up to 100m (330 ft.) apart, and greater distances are possible with the use of

fiber optics. EtherCAT® also has additional features that offer further topological flexibility, such as Hot Connect and Hot Swap for devices, and added redundancy through a ring topology.

EtherCAT® is suitable for both centralized and decentralized system architectures. It can support master-slave, master-master, and slave-slave communication as well as incorporate subordinate field buses. At the factory-level, the EtherCAT® Automation Protocol has communication covered – all with the existing infrastructure.

When compared to a classic field bus system, EtherCAT® is the obvious choice: node addresses can be set automatically, there's no need for network tuning, and onboard diagnostics with fault localization make pinpointing errors a snap. Despite these advanced features, EtherCAT® is also easier to use than Industrial Ethernet: there are no switches to configure, and no complicated handling of MAC or IP addresses is required.

EtherCAT® also supports common internet technologies without jeopardizing the network's real-time capability. Its "Ethernet over EtherCAT®" protocol transports FTP, http, TCP/IP and Co.

Other functions (offset values, resolution, etc) can be configured. The absolute rotary encoder corresponds to the class 1 encoder profile (DS 406 in which the characteristics of encoder with CANopen interface are defined).

Further information is available at:


EtherCAT Technology Group
<http://www.ethercat.org>

A detailed description of the network is described in the following chapters.

ABSOLUTE ROTARY ENCODER ETHERCAT®

3 Hardware Set-Up and Ethernet Connection

3.1 Network Topology

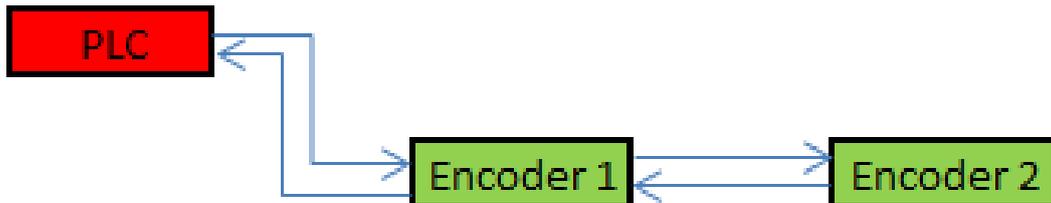

The line structure can be built up like known from standard field bus systems e.g. CANopen. The sensor can be connected to other devices by usage of “straight” or crossover network cable, because the PHY of the encoder is capable to realize Auto crossover. You need at least a cable of category Cat5e to get a data transfer rate up to 100 Mbit. To increase noise immunity only cables with foil and copper netting shield should be used (S/UTP), twisted pair, AWG26.

The symbolized structure shows a line cabling structure.

Each device can be connected together with a maximum cable length of 100m.

These requirements are specified in EtherCAT® specification. For more details visit the web site: <http://www.ethercat.org>

**ABSOLUTE ROTARY ENCODER
ETHERCAT®**

4 Connection an Absolute Encoder


The encoder is connected by a 4 pin A-coded M12 connector for the power supply and two 4 pin, D-coded M12 connector for Ethernet.

4.1 Connector Ethernet EtherCAT®

4 pin female, D-coded

Pin Number	Signal
1	Tx +
2	Rx +
3	Tx -
4	Rx -

Sketch on encoder view




4.2 Connector Power Supply

4 pin male, A-coded

Pin Number	Signal
1	power supply (10V – 30V)
2	Reserved, not connected
3	power supply (GND)
4	Reserved, not connected

Sketch on encoder view





ABSOLUTE ROTARY ENCODER
ETHERCAT®

4.3 Ethernet Cables

RJ45 – M12 crossed

Signal	RJ45 Pin	M12 Pin	Signal
Tx+	3	2	Rx+
Tx-	6	4	Rx-
Rx+	1	1	Tx+
Rx-	2	3	Tx-

RJ45 – M12 straight

Signal	RJ45 Pin	M12 Pin	Signal
Tx+	3	1	Tx+
Tx-	6	3	Tx-
Rx+	1	2	Rx+
Rx-	2	4	Rx-

M12 – M12 crossed

Signal	M12 Pin	M12 Pin	Signal
Tx+	1	2	Rx+
Tx-	3	4	Rx-
Rx+	2	1	Tx+
Rx-	4	3	Tx-



ABSOLUTE ROTARY ENCODER ETHERCAT®

5 Diagnostic LED's

The encoder provides on the backside of the connection cap several diagnostic LEDs. For each port there is a functional combined LED for link status and activity named "LS/DA".

Furthermore there are two LEDs to indicate the network status for EtherCAT® named "error" and "Status". The exact meaning of the LED indication is specified in the following tables.

5.1 Function of LEDs for Ports

LED	Color	Status	Description for LED = on
Link/Act IN	Green	On	LINK is active for HUB port 1
		Blinking	Activity on HUB port 1
Link/Act OUT	Green	On	LINK is active for HUB port 2
		Blinking	Activity on HUB port 2

5.2 Function of LEDs for EtherCAT®

LED	Color	Status	Description for LED
Error	Red	Off	No Error
		Blinking	Invalid Configuration
		Single Flash	Local Error
		Double Flash	Process Data Watchdog Timeout/EtherCAT® Watchdog Timeout
		Flickering	Booting Error
		On	Application Failure
Run	Green	Off	Initialization
		Blinking	Pre-Operational
		Single flash	Safe-Operational
		Flickering	Initialization or Bootstrap
		On	Operational

ABSOLUTE ROTARY ENCODER ETHERCAT®

6 Network Configuration



A dismantling of the connection cap is not allowed! All configurations can be directly executed without opening the housing.

6.1 Install Encoders to Network

- 1.) Turn off the power supply for your machine
- 2.) Connect the Ethernet CAT5 cable with D-coded M12 connector from the PLC or the last device to the ECAD IN-Port
- 3.) If necessary install additional devices to the ECAD OUT-Port
- 4.) Connect the A-coded M12 connector for the power supply
- 5.) Turn on the power supply of the PLC and the devices

USER MANUAL
ABSOLUTE ROTARY ENCODER
ETHERCAT®

7 Project Integration

This integration description is an example related to Beckhoff control units with TwinCAT®. In general the user can integrate the encoder in any project tool or hardware set up using an EtherCAT® network.

Note:

- TwinCAT® needs special network cards with INTEL-Chip. See further information @ Beckhoff.
- Start TwinCAT® with Administration rights.

7.1 ESI File

A ESI file describes the properties and functions of the sensor like timings and configurable sensor parameters. By using the ESI file an easy and abstract integration of an EtherCAT® device in a project tool is realized. A detailed knowledge of EtherCAT® is not needed to configure the device.

An actual ESI file can be downloaded from the website: www.posital.eu

The format of the ESI file is XML and is similar like an EDS file used in the CANopen world.

7.2 Configuration with TwinCAT® 2

7.2.1 Import the ESI file

Copy the ESI file in the following directory:

...\TwinCAT\IO\Ethercat


7.2.2 Setup encoder device

Press **F5 key** or click right mouse button on I/O Devices and select **Scan Devices...**




ABSOLUTE ROTARY ENCODER ETHERCAT®

Select **OK Button**

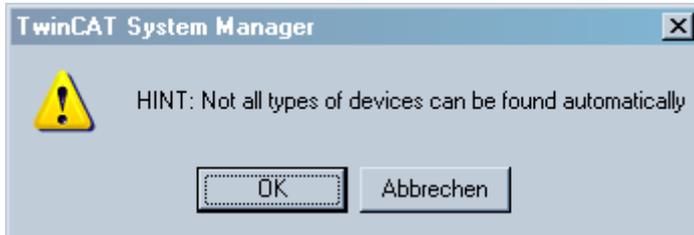


Select the network adapter where the EtherCAT® devices are connected

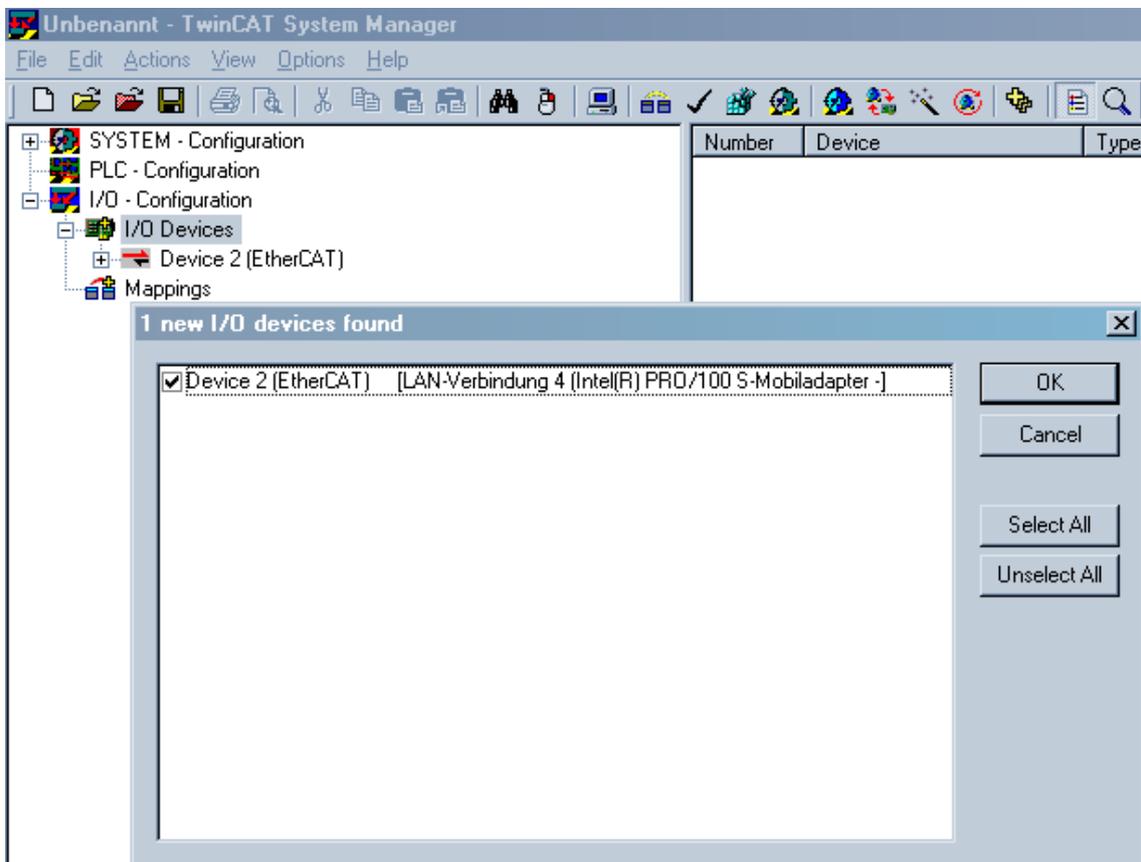


ABSOLUTE ROTARY ENCODER ETHERCAT®

Accept to scan for boxes

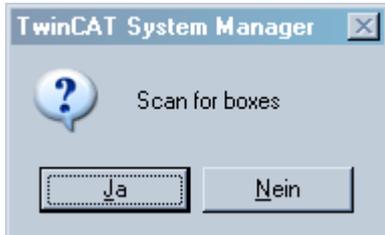


Accept to go in Free Run modus (Set/Reset TwinCAT® **Shift+F4** or click the marked button)

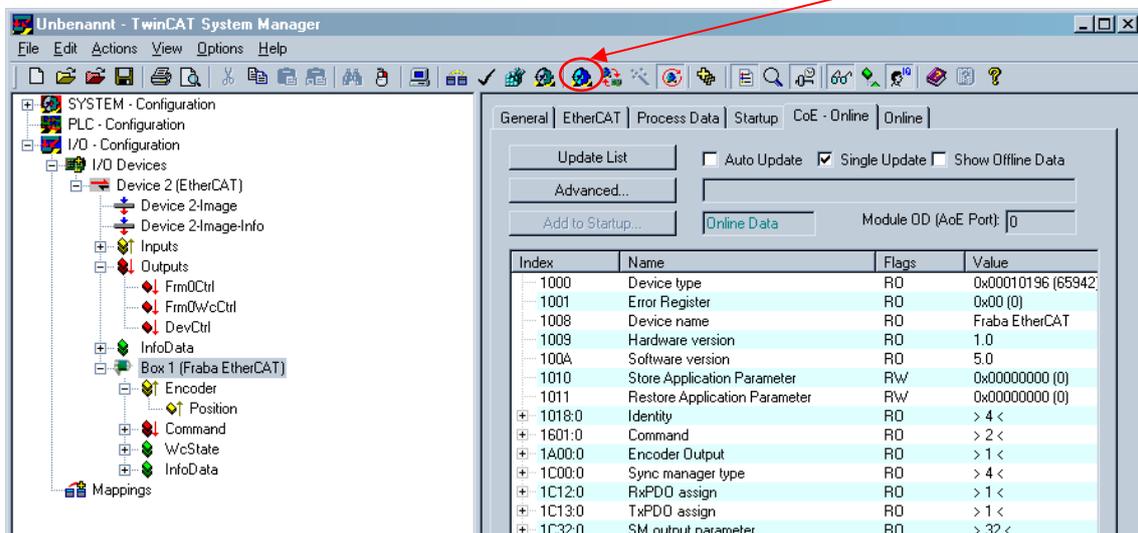




ABSOLUTE ROTARY ENCODER ETHERCAT®

In the Free Run modus the communication between TwinCAT® and devices amount the cycle time 4ms. The position value is available i.e. the next screenshot.

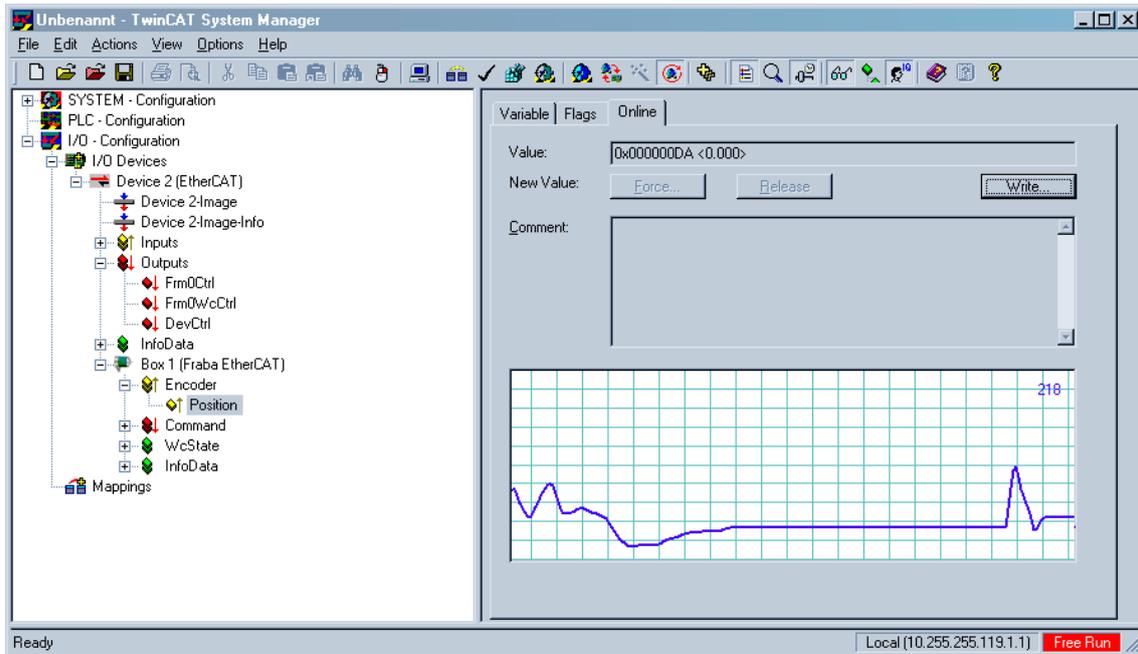

ABSOLUTE ROTARY ENCODER ETHERCAT®

7.2.3 Objects

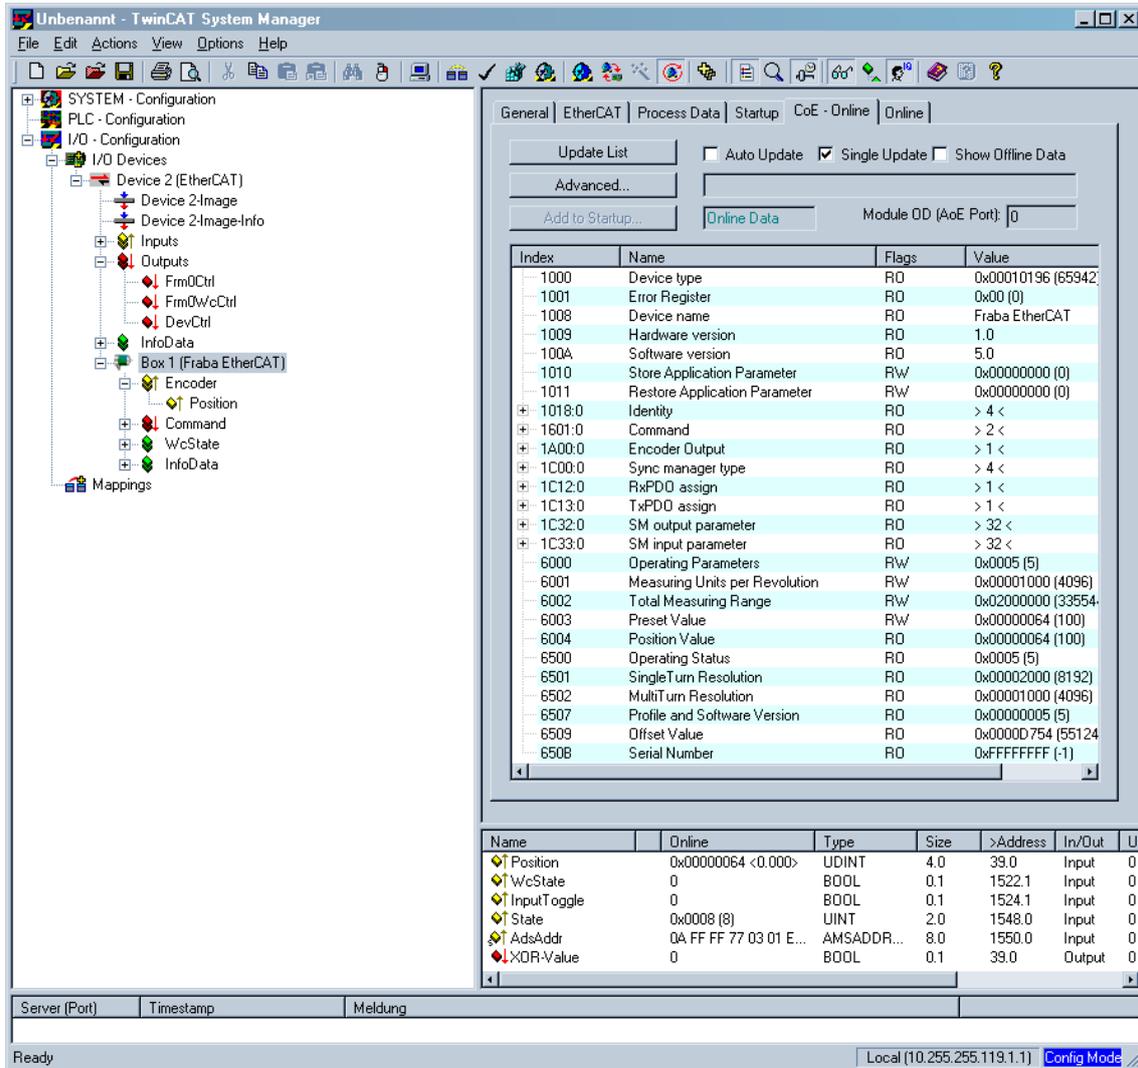

The screenshot shows the TwinCAT System Manager interface. The left sidebar displays a tree view of the system configuration, with 'Box 1 (Fraba EtherCAT)' selected. The main panel shows the 'General' tab for the selected device, displaying a list of parameters and their values.

Index	Name	Flags	Value
1000	Device type	RO	0x00010196 (65942)
1001	Error Register	RO	0x00 (0)
1008	Device name	RO	Fraba EtherCAT
1009	Hardware version	RO	1.0
100A	Software version	RO	5.0
1010	Store Application Parameter	RW	0x00000000 (0)
1011	Restore Application Parameter	RW	0x00000000 (0)
1018:0	Identity	RO	> 4 <
1601:0	Command	RO	> 2 <
1A00:0	Encoder Output	RO	> 1 <
1C00:0	Sync manager type	RO	> 4 <
1C12:0	RxPDO assign	RO	> 1 <
1C13:0	TxPDO assign	RO	> 1 <
1C32:0	SM output parameter	RO	> 32 <
1C33:0	SM input parameter	RO	> 32 <
6000	Operating Parameters	RW	0x0005 (5)
6001	Measuring Units per Revolution	RW	0x0001000 (4096)
6002	Total Measuring Range	RW	0x02000000 (33554)
6003	Preset Value	RW	0x00000064 (100)
6004	Position Value	RO	0x00000064 (100)
6500	Operating Status	RO	0x0005 (5)
6501	SingleTurn Resolution	RO	0x00002000 (8192)
6502	MultiTurn Resolution	RO	0x00001000 (4096)
6507	Profile and Software Version	RO	0x00000005 (5)
6509	Offset Value	RO	0x0000D754 (55124)
650B	Serial Number	RO	0xFFFFFFFF (-1)


Name	Online	Type	Size	>Address	In/Out	U
Position	0x00000064 <0.000>	UDINT	4.0	39.0	Input	0
WcState	0	BOOL	0.1	1522.1	Input	0
InputToggle	0	BOOL	0.1	1524.1	Input	0
State	0x0008 (8)	UINT	2.0	1548.0	Input	0
AdsAddr	0A FF FF 77 03 01 E...	AMSADDR...	8.0	1550.0	Input	0
XDR-Value	0	BOOL	0.1	39.0	Output	0

At the bottom of the window, the status bar shows 'Ready' and 'Local (10.255.255.119.1.1) Config Mode'.


ABSOLUTE ROTARY ENCODER ETHERCAT®

7.2.4 Set Preset value

In this sample the Preset value is set to 100. Double click on Preset. After confirmation with **OK** the Position value switch to 100. **Note:** Set object 1010h from chapter 8 to save all parameters to the non volatile memory!

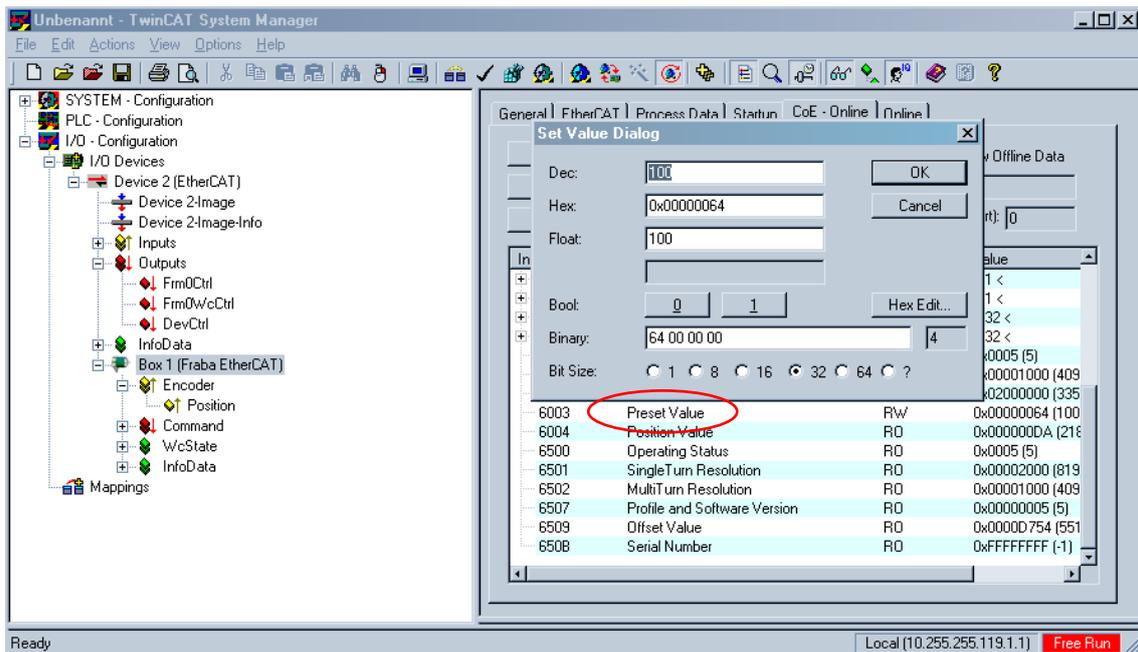


7.2.5 Set Base Time for Real-time mode

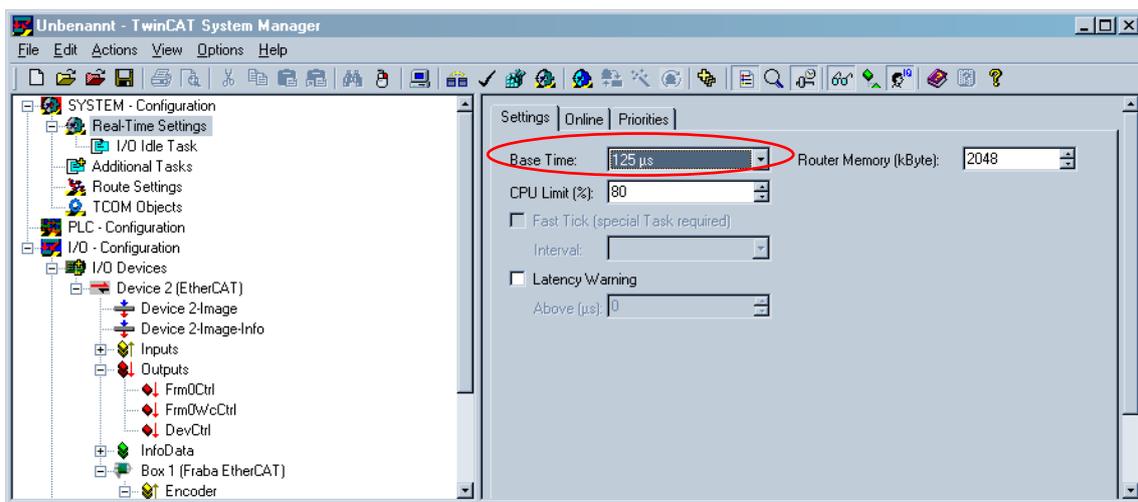


ABSOLUTE ROTARY ENCODER ETHERCAT®

7.2.6 Mapping of parameters

If no external EtherCAT®-Master is in use (only Laptop as Master) then an additional task is necessary. After right mouse click on Inputs it is possible to insert a variable.

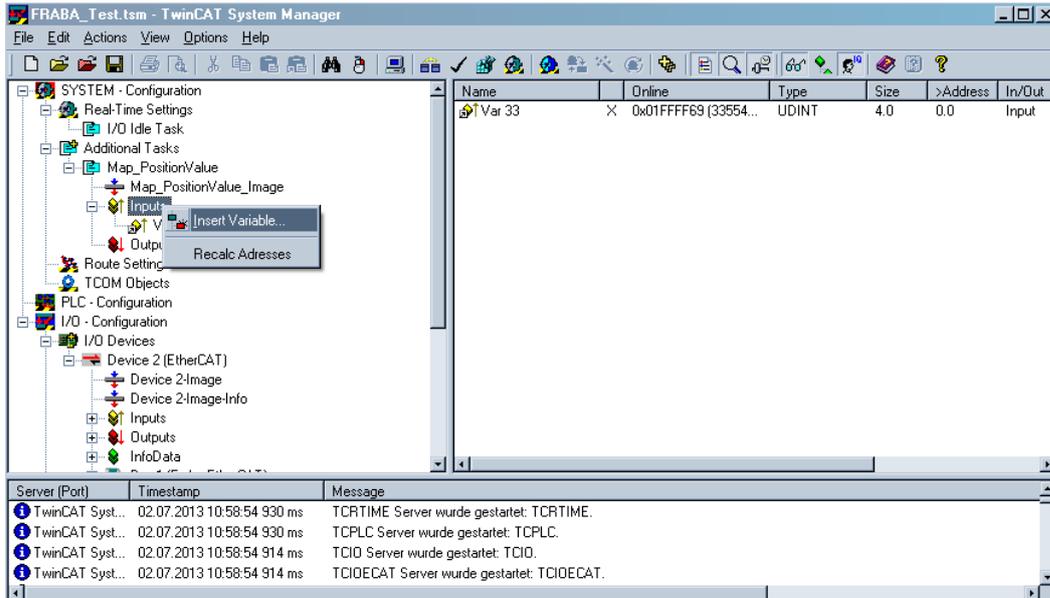


Set Checkbox for Auto start to get back position values

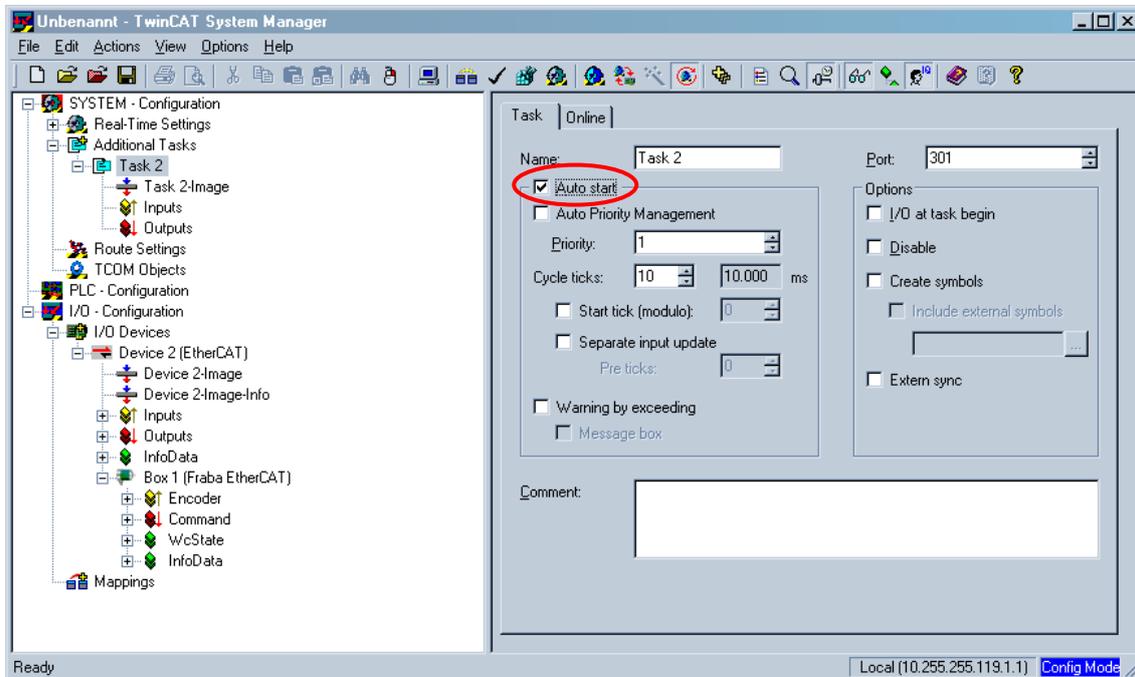



ABSOLUTE ROTARY ENCODER ETHERCAT®

Go in Set/Reset TwinCAT® in Run Mode (**CTRL+F4**)

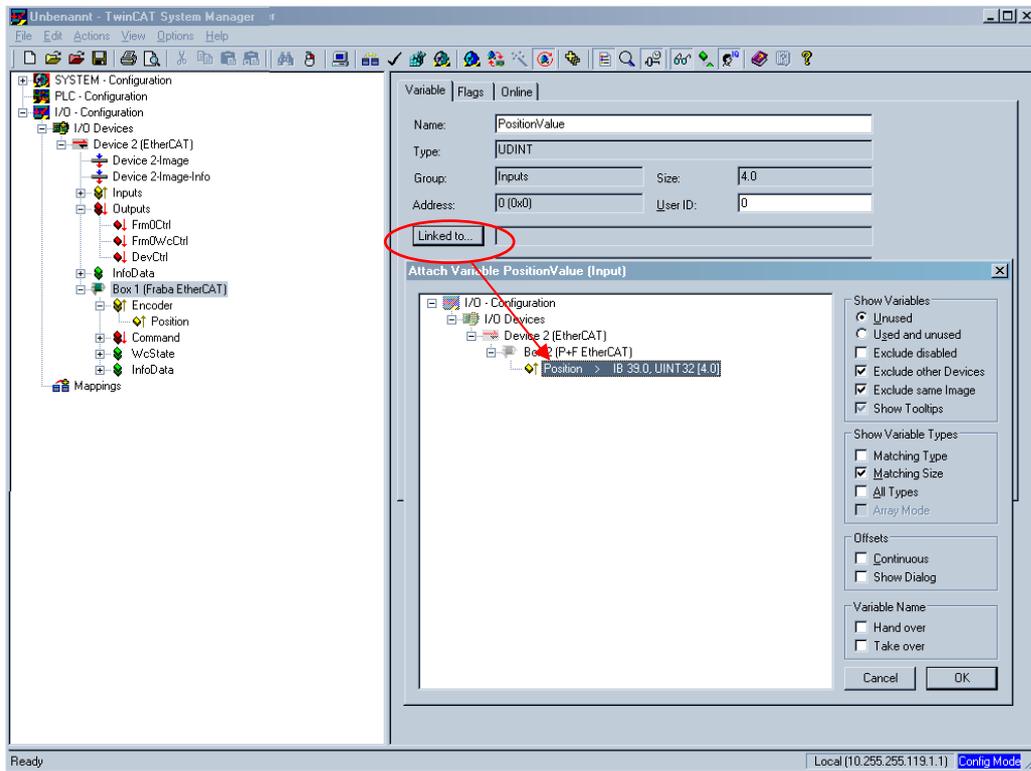

ABSOLUTE ROTARY ENCODER ETHERCAT®

7.2.7 Distributed Clocks

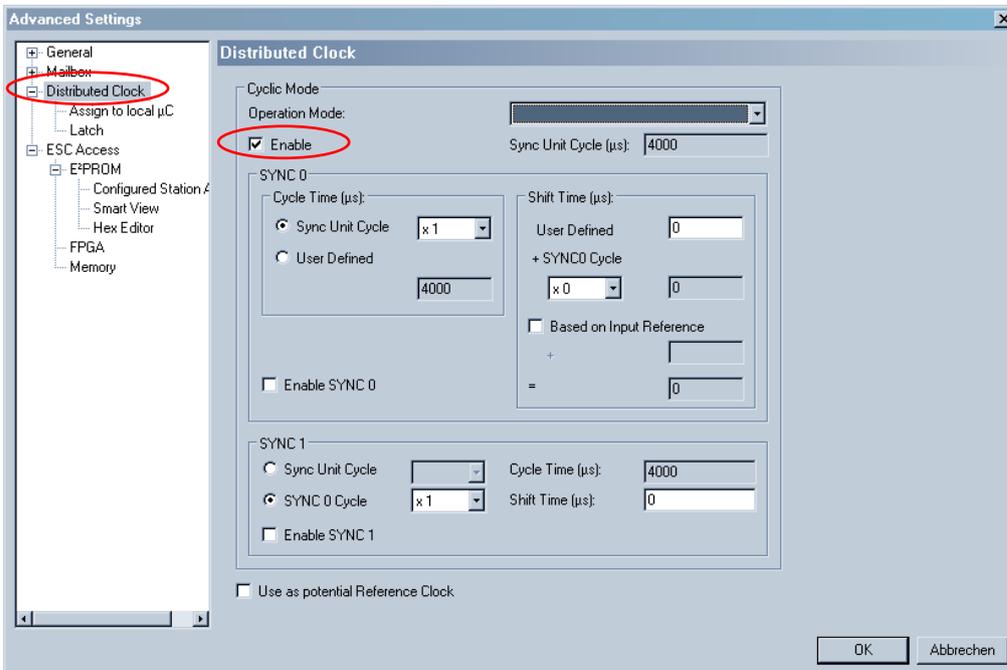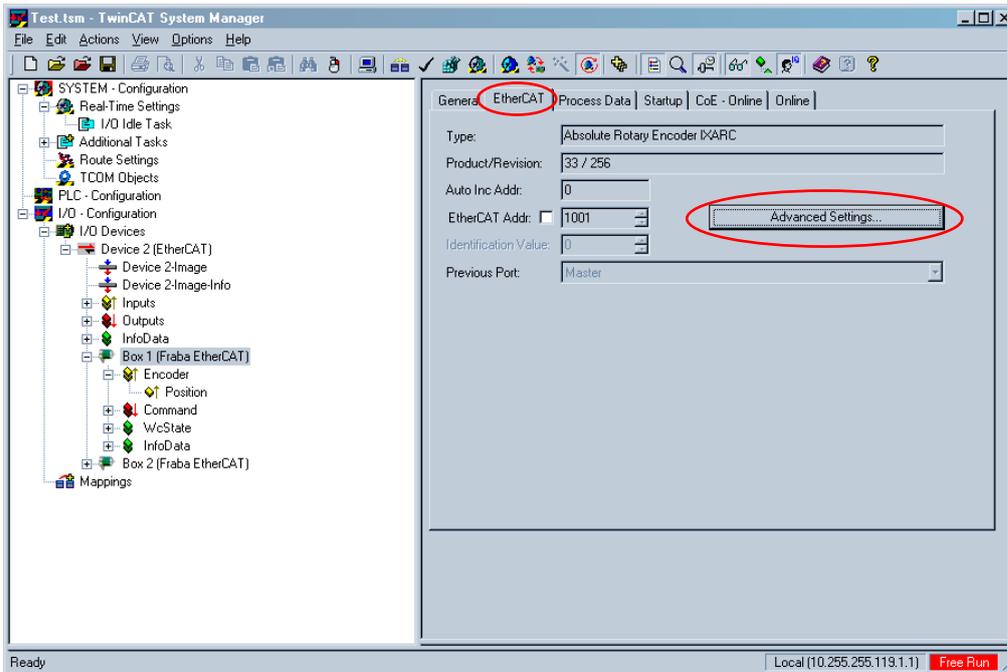


ABSOLUTE ROTARY ENCODER ETHERCAT®


7.2.8 Remote Firmware Update

Execute remote firmware update always in “TwinCAT config mode”.

- 1) Set encoder state machine to bootstrap mode. Click “Download”.

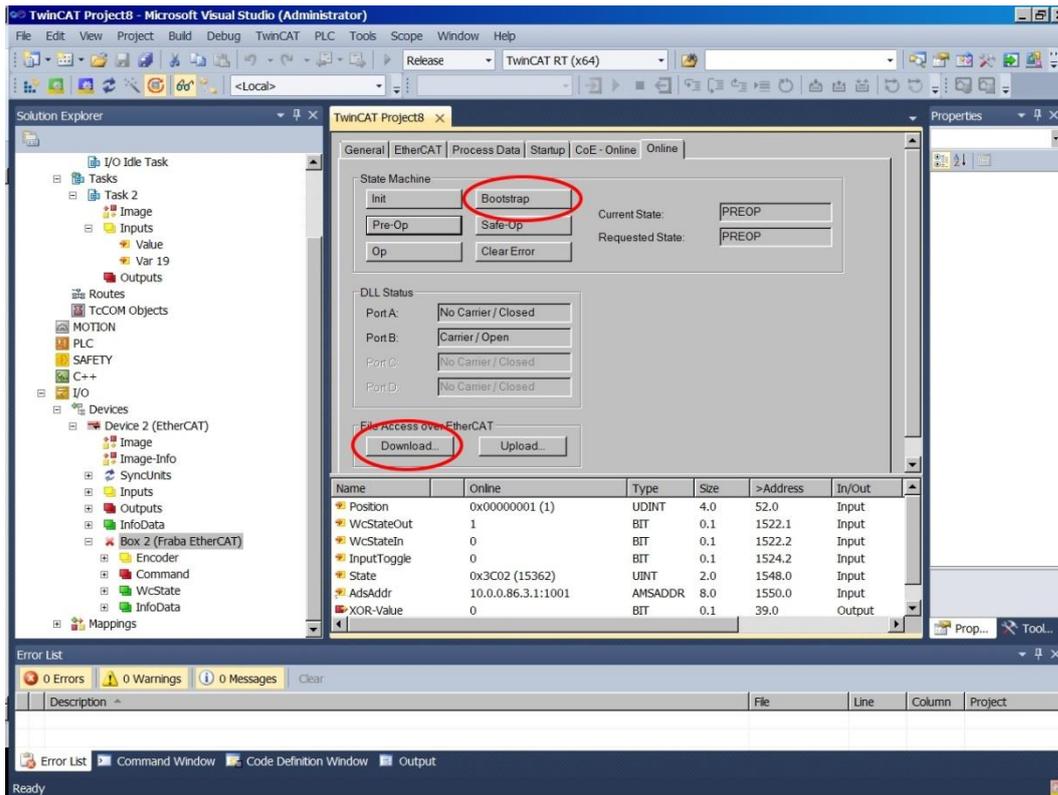

- 2) Select in the drop menu all file name extensions (*.*)

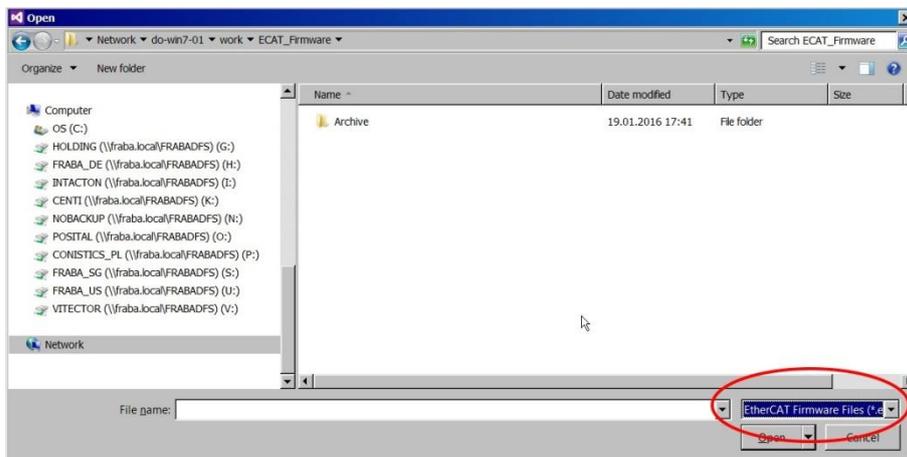



ABSOLUTE ROTARY ENCODER ETHERCAT®

3) Select correct firmware version to be updated and enter the Password.

String:

Hex:

Length:

Password (hex):

4) Bootloading may end in error message that can be ignored.

 Failed to download file to 'Box 2 (Fraba EtherCAT)'(1001).
ADS Error 1810 (0x712): 'ADS ERROR: server is in invalid state'

ABSOLUTE ROTARY ENCODER ETHERCAT®

7.3 Configuration with TwinCAT® 3


7.3.1 Import the ESI file

Copy the ESI file in the following directory:

...\TwinCAT\3.1\Config\Io\EtherCAT

7.3.2 Create project

Add New Item under Devices

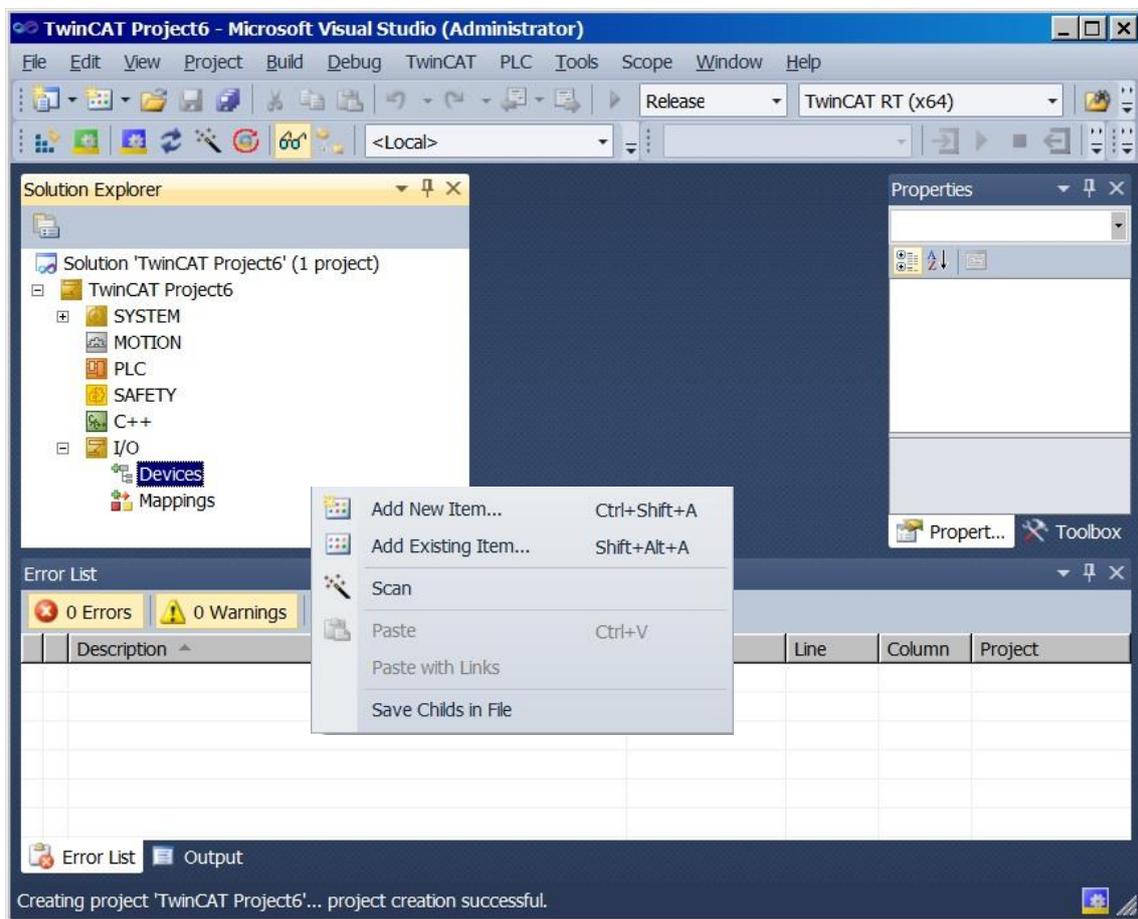




ABSOLUTE ROTARY ENCODER ETHERCAT®

If ESI-File was not installed you get the following message:




The encoder is available under the EtherCAT® Device (network card) as Box under InfoData (see encoder icon).

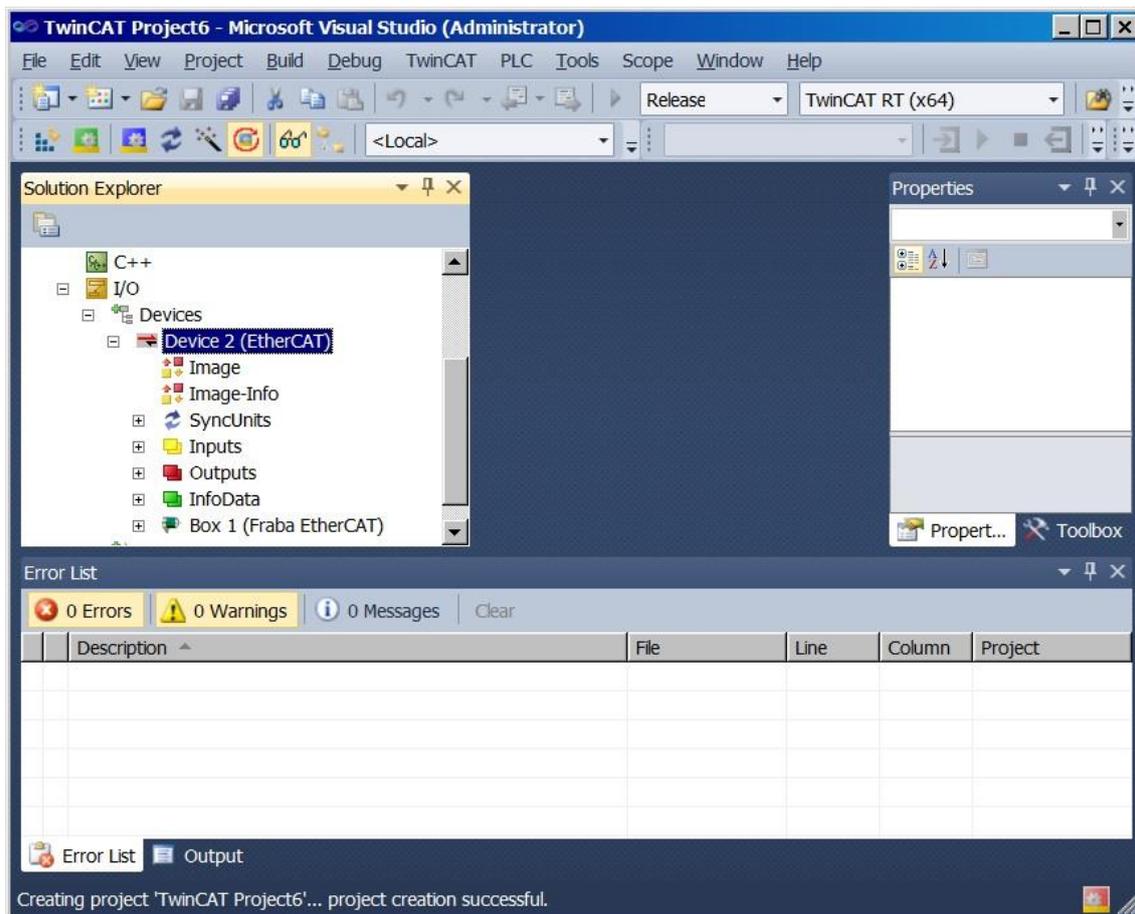



ABSOLUTE ROTARY ENCODER ETHERCAT®


Under the tabs is it possible to set the different configurations.

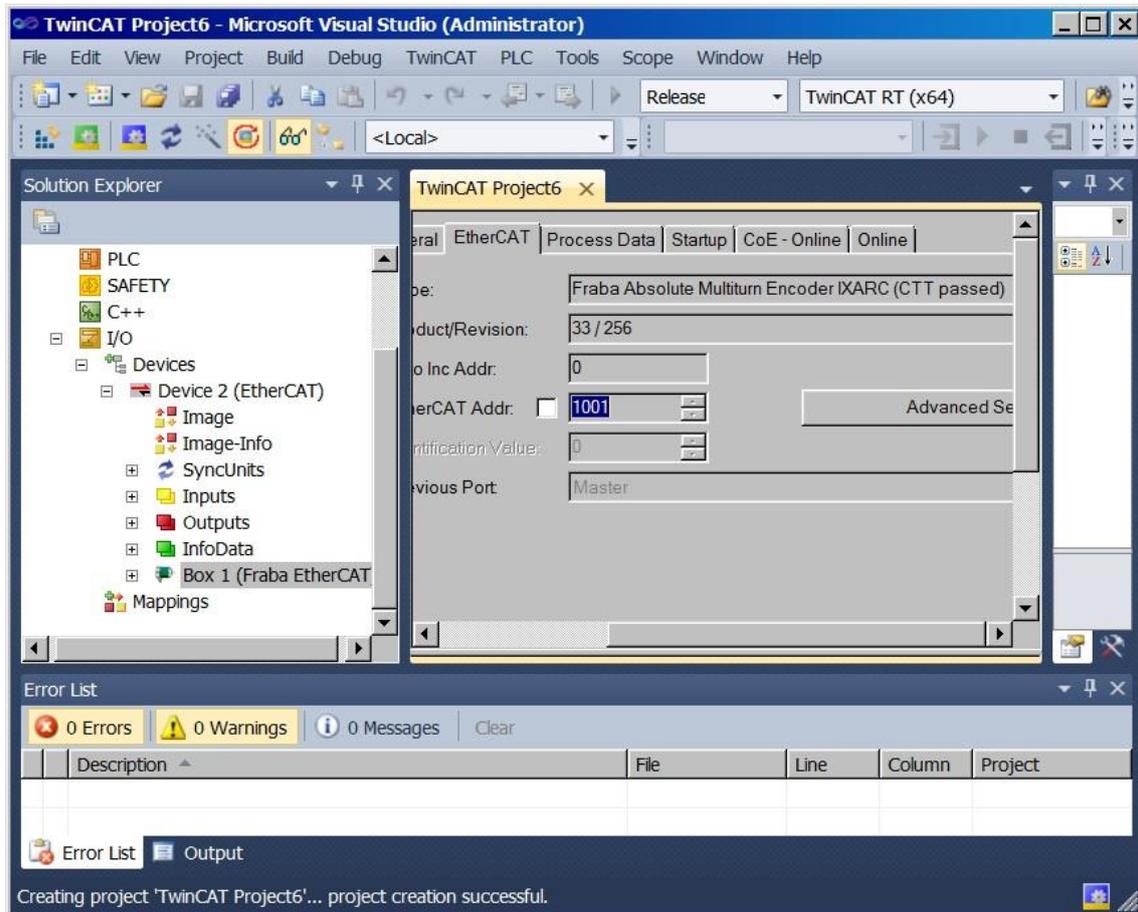




ABSOLUTE ROTARY ENCODER ETHERCAT®

Change the device to an explicit name.

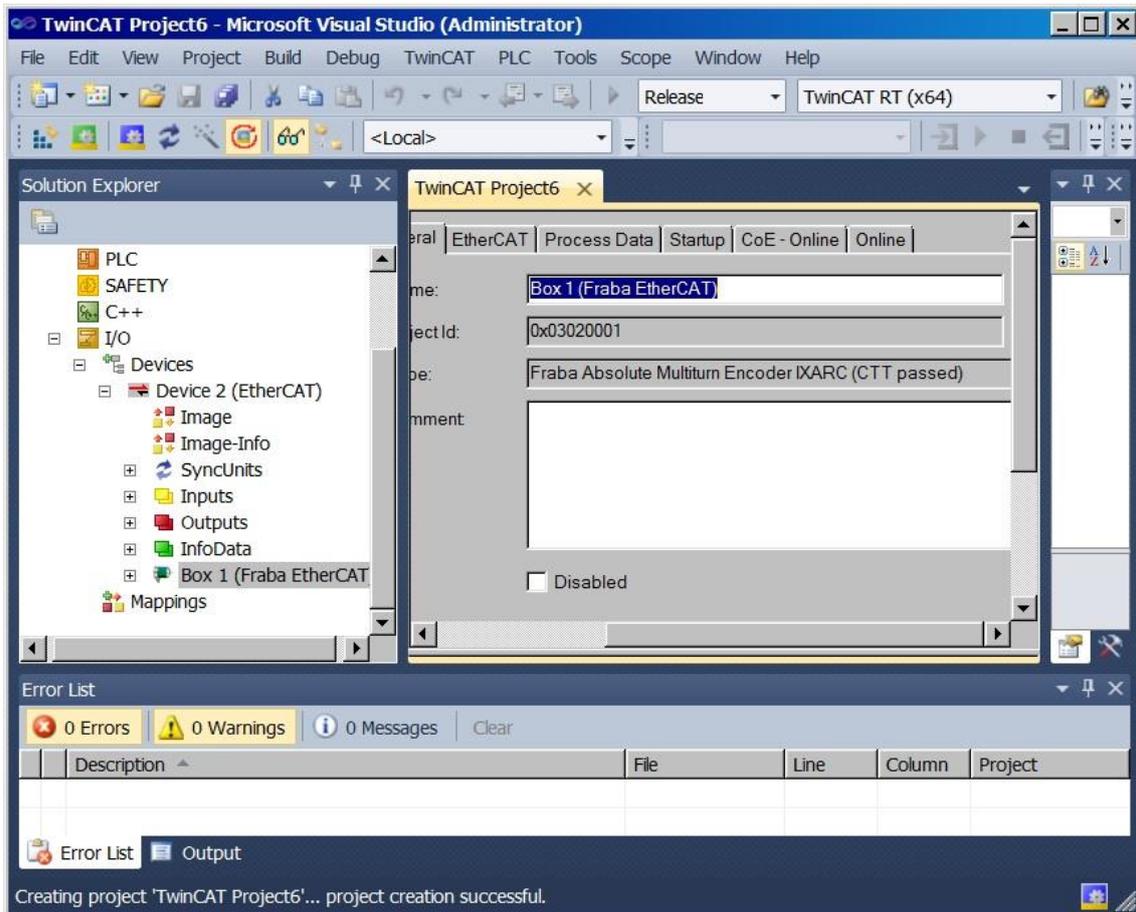


ABSOLUTE ROTARY ENCODER ETHERCAT®

If no external EtherCAT®-Master is in use (only Laptop as Master) then an additional task is necessary. After

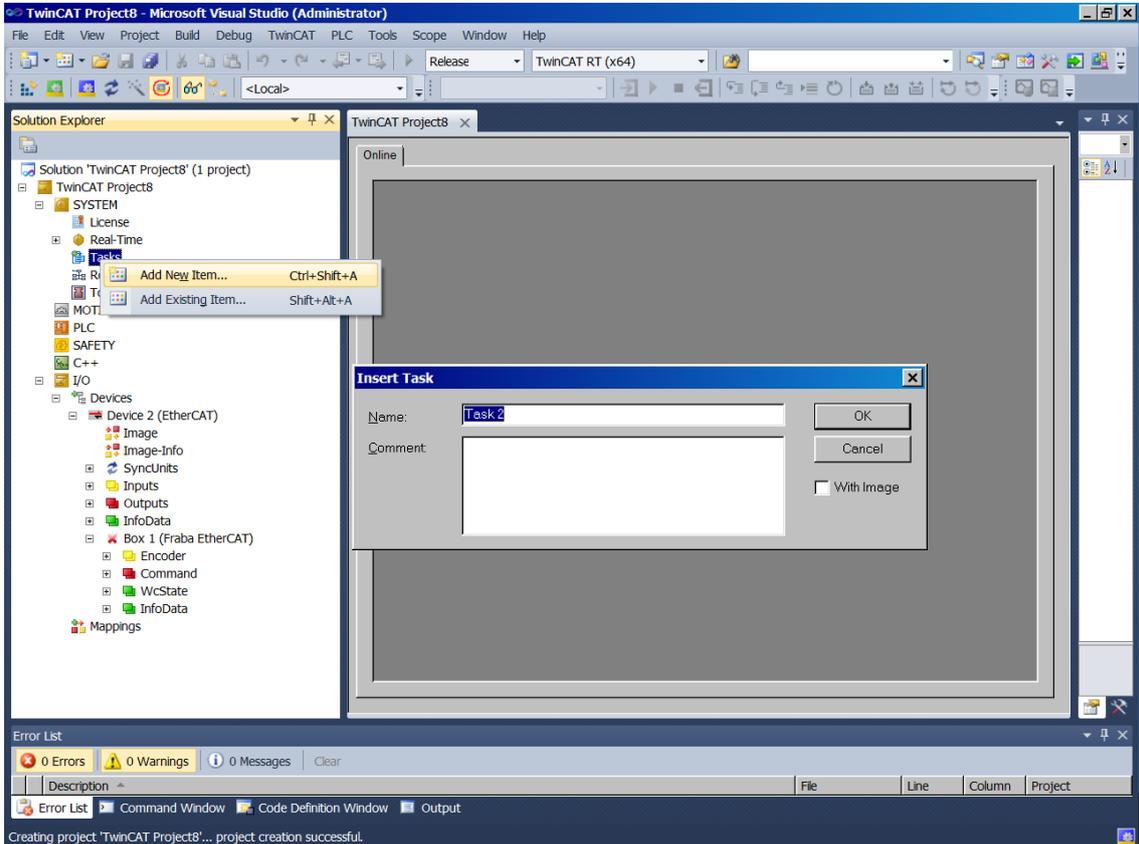



ABSOLUTE ROTARY ENCODER ETHERCAT®

Activate Auto start

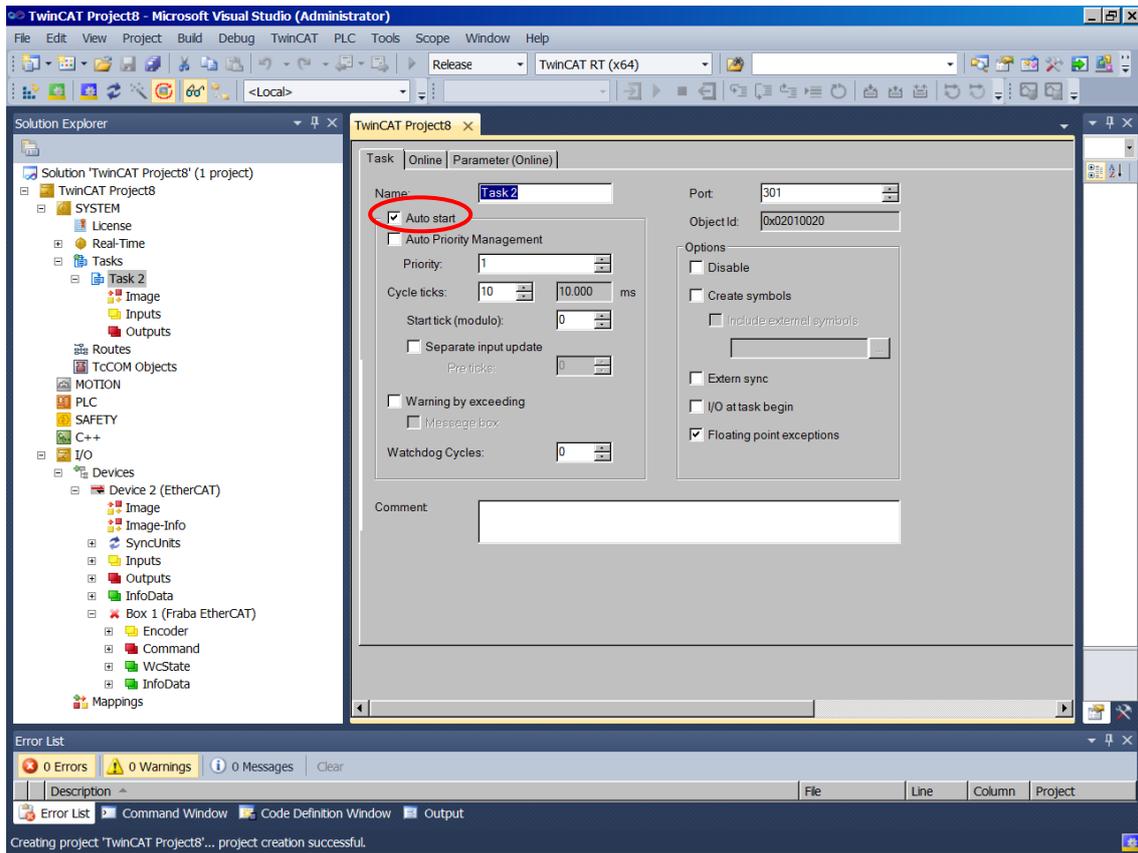



ABSOLUTE ROTARY ENCODER ETHERCAT®

Add New Item under Input and set the attributes

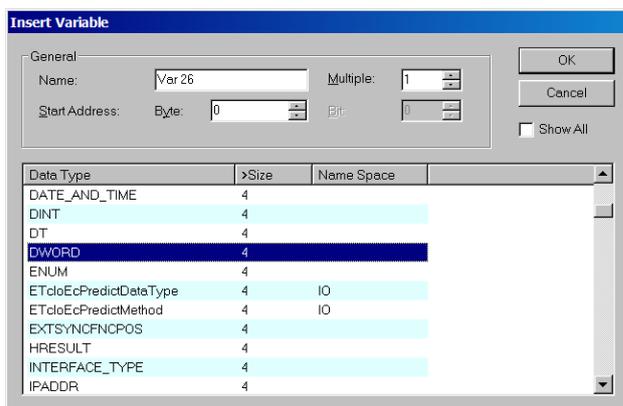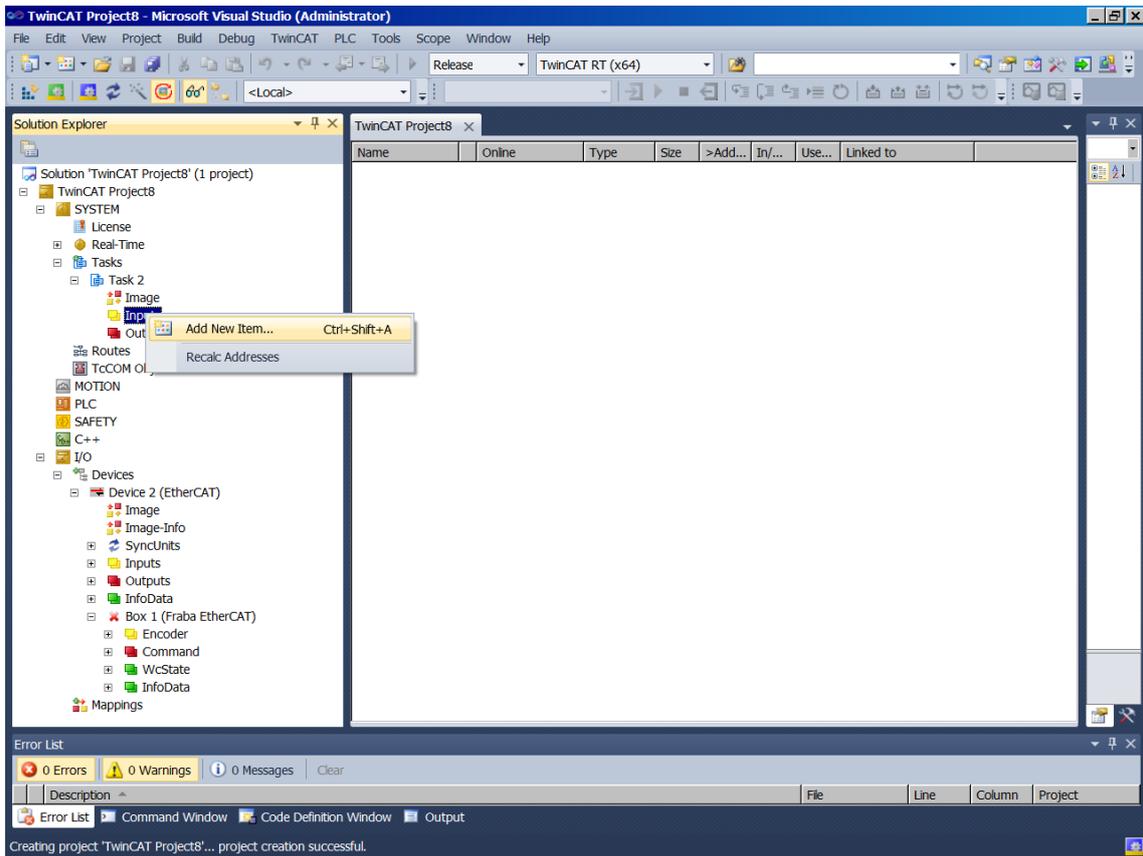


ABSOLUTE ROTARY ENCODER ETHERCAT®

Attach the necessary variable

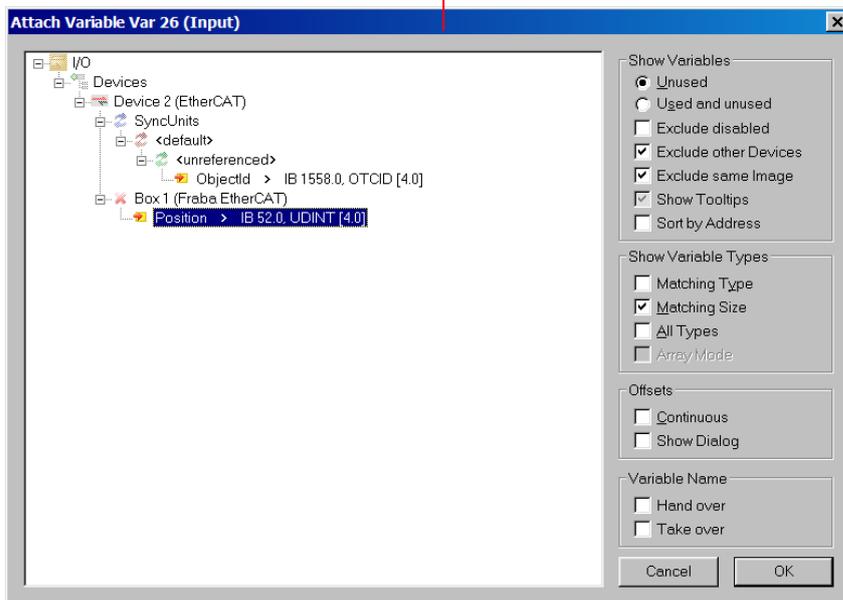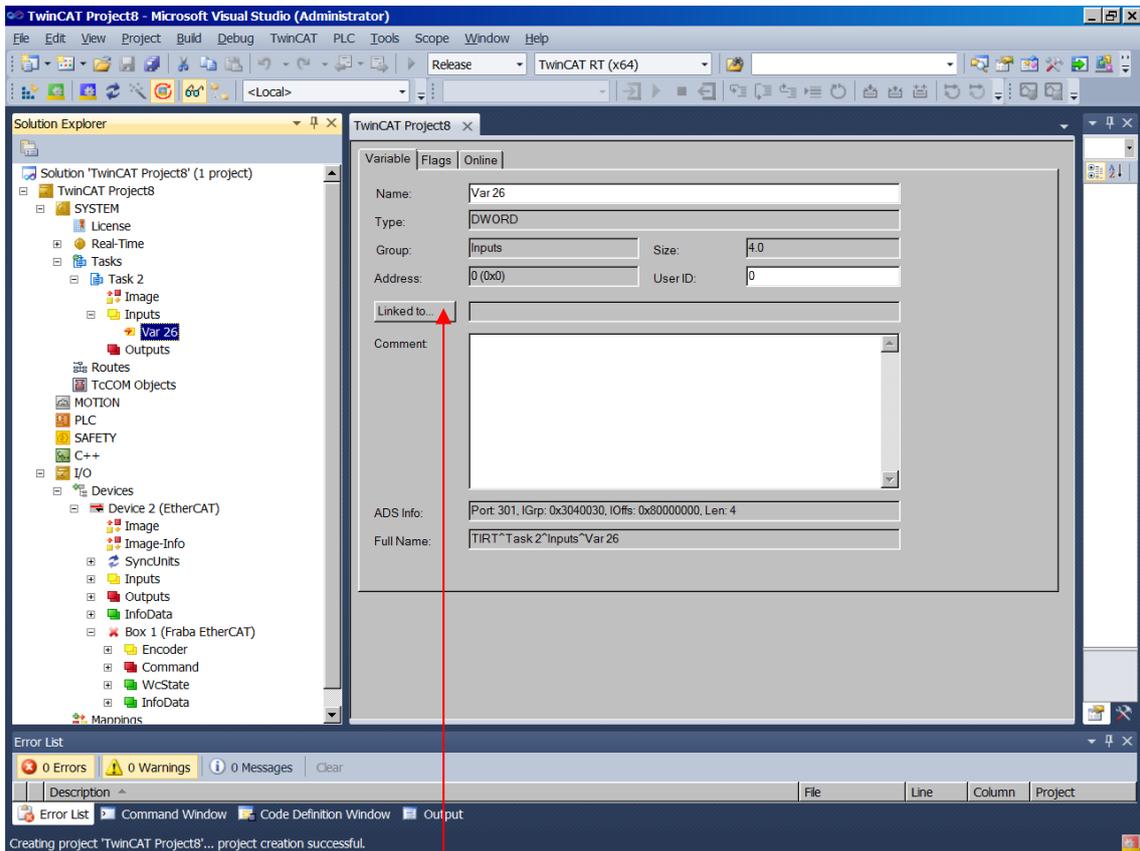



ABSOLUTE ROTARY ENCODER ETHERCAT®

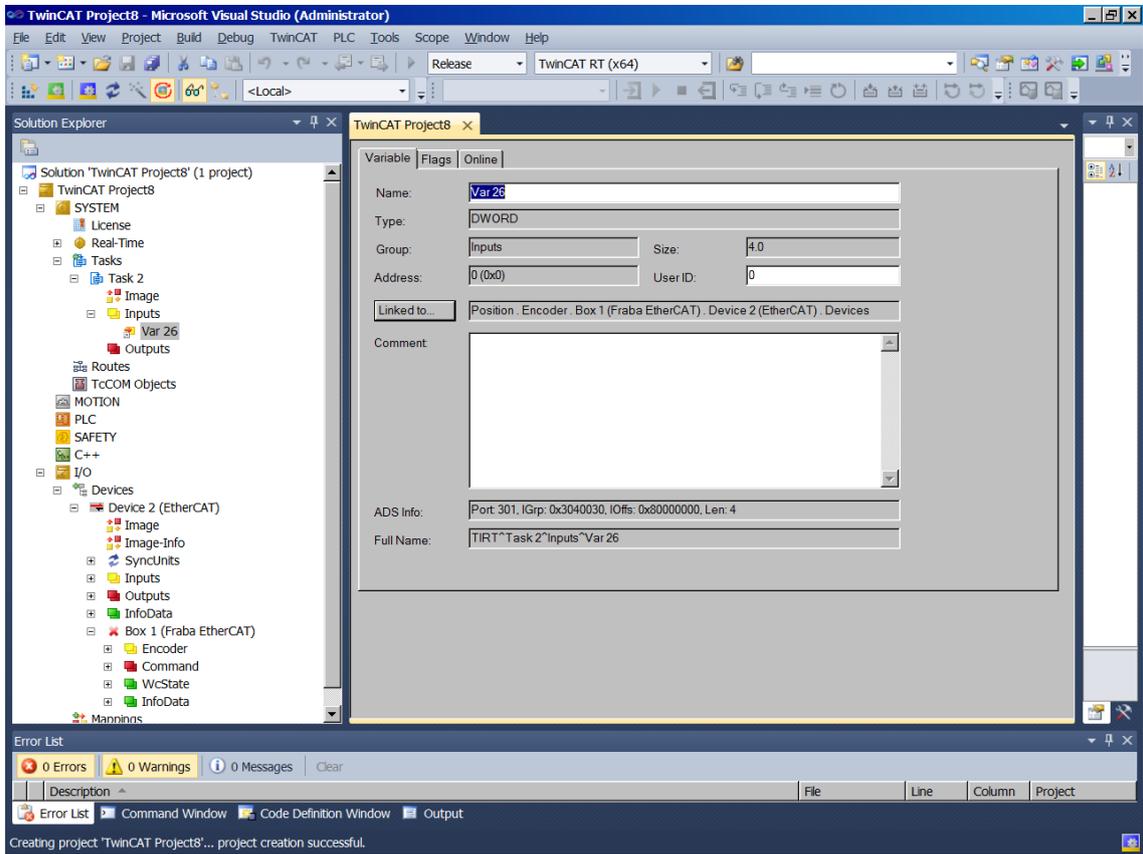



ABSOLUTE ROTARY ENCODER ETHERCAT®

7.4 Diagnostic

If problems occur it is possible to conduct diagnosis with standard Ethernet tools like Wireshark (<http://www.wireshark.org>). It is one tool of many available on the market which can be used, because EtherCAT® is using standard Ethernet frames. With this tool an interpretation of Ethernet frames according to EtherCAT® is possible. Just the right filter "ECAT" has to be selected and the user has a powerful tool. In case of problems it is

recommended to log a trace for own analysis or send this log to Fraba for further evaluation purposes.

Anyhow our experience is, that this tool has also restrictions at very low EtherCAT® cycles and that you cannot trust time stamps and the order of logged telegrams. In those cases contact Beckhoff for support.

The screenshot displays the Wireshark interface for a capture on a local area connection. The packet list shows several ECAT frames. The packet details pane for frame 7252 shows the following structure:

- EtherCAT frame header
- EtherCAT datagram(s): 3 Cmds, 'LRD': len 1, 'LRW': len 4, 'BRD': len 2
 - EtherCAT datagram: Cmd: 'LRD' (10), Len: 1, Addr 0x9000000, Cnt 1
 - Header
 - Data: 00
 - Working Cnt: 1
 - EtherCAT datagram: Cmd: 'LRW' (12), Len: 4, Addr 0x1000000, Cnt 3
 - Header
 - Data: f8bc0000
 - Working Cnt: 3
 - EtherCAT datagram: Cmd: 'BRD' (7), Len: 2, Addr 0x1, Addr 0x130, Cnt 1

The packet bytes pane shows the raw data in hexadecimal and ASCII:

```
0010 0a 00 00 00 00 09 01 80 00 00 00 01 00 0c 8d 00 .....
0020 00 00 01 04 80 00 00 f8 bc 00 00 03 00 07 00 01 .....
0030 00 30 01 02 00 00 00 08 00 01 00 00 .....

```



ABSOLUTE ROTARY ENCODER ETHERCAT®

8 Communication Profile

The CANopen communication profiles have been overtaken for the EtherCAT® protocol to minimize integration effort for the customer. This means for encoders, that communication parameters are corresponding to the profile DS301 V4.02. In the following table the supported parameters are listed:

Object	Description	Data type	Access type
1010h	Store application parameter	Unsigned 32	r / w
1011h	Restore application parameter	Unsigned 32	r / w

Object 1010h: Store application parameter

This object shall save all parameters to the non volatile memory.

Subindex	Description	Data Type	Default Value	Access
0h	Store all parameters	Unsigned 32	65766173h	rw

To save the parameters to non volatile memory the access signature 65766173h has to be sent to the corresponding subindex of the device.

Object 1011h: Restore application parameter to manufacture default value

This object shall restore parameters 6000-6003 to the default values and store to the non volatile memory.

Subindex	Description	Data Type	Default Value	Access
0h	Restore parameters 6000-6003	Unsigned 32	64616F6Ch	rw

To restore the parameters to non volatile memory the access signature 64616F6Ch has to be sent to the corresponding subindex of the device.



ABSOLUTE ROTARY ENCODER ETHERCAT®

9 Encoder Profile

The CANopen Device profiles have been overtaken for the EtherCAT® protocol to minimize integration effort for the customer. This means for encoders, that device parameters are corresponding to the profile DS406. In the following table the supported parameters are listed:

Object	Description	Data type	Access type
6000h	Operating Parameters	Unsigned 16	r / w
6001h	Measuring units per revolution	Unsigned 32	r / w
6002h	Total measuring range in measuring units	Unsigned 32	r / w
6003h	Preset value	Unsigned 32	r / w
6004h	Position Value	Unsigned 32	r / w
6500h	Operating status	Unsigned 16	r
6501h	Single-turn resolution	Unsigned 32	r
6502h	Number of distinguishable revolutions	Unsigned 32	r
6507h	Profile and Software Version	Unsigned 32	r
6509h	Offset Value	Unsigned 32	r
650Bh	Serial Number (fits to Identity Object 1018h)	Unsigned 32	r

USER MANUAL
ABSOLUTE ROTARY ENCODER
ETHERCAT®

Object 6000h: Operating parameters

This object shall indicate the functions for code sequence, commissioning diagnostic control and scaling function control

Subindex	Description	Data Type	Default Value	Access
0h	Operating Parameter	Unsigned 16	4h	rw

Code sequence: The code sequence defines, whether increasing or decreasing position values are output, in case the encoder shaft rotates clockwise or counter clockwise as seen from the point of view of the shaft.

encoder. The measuring units per revolution (object 6001h) and total measuring range in measuring units (object 6002h) are the scaling parameters. The scaling function bit is set in the operating parameters. If the scaling function bit is set to zero, the scaling function is disabled.

Scaling function control: With the scaling function the encoder numerical value is converted in software to change the physical resolution of the

Set object 1010h from chapter 8 to save all parameters to the non volatile memory!

Bit structure for the operating parameters

Bit	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
Use	MS	MS	MS	MS	R	R	R	R	R	R	R	R	MD	SFC	CD	CS

Table Description:

- MS: Manufacturer Specific Function (not available)
- R: Reserved for future use
- MD: Measuring direction (not available)
- SFC: Scaling function (0 = disable, 1 = enable)
- CD: Commissioning diagnostic control (not available)
- CS: Code sequence (0 = CW, 1 = CCW)

Object 6001h: Measuring units per revolution

This object shall indicate the number of distinguishable steps per revolution.

Subindex	Description	Data Type	Default Value	Access
0h	Measuring units per revolution	Unsigned 32	See type shield	rw

Attention: The ESI file has as default value 2000 hex. This value has to be adapted in the project tool to the specific encoder value. Please refer to the type shield for the type key and data sheet.

USER MANUAL
ABSOLUTE ROTARY ENCODER
ETHERCAT®

Set object 1010h from chapter 8 to save all parameters to the non volatile memory!

Object 6002h: Total measuring range in measuring units

This object shall indicate the number of distinguishable steps over the total measuring range.

Subindex	Description	Data Type	Default Value	Access
0h	Total measuring steps	Unsigned 32	see type shield	rw

Attention: The ESI file has as default value 1000 hex. This value has to be adapted in the project tool to the specific encoder value. Please refer to the type shield for the type key and data sheet.

Set object 1010h from chapter 8 to save all parameters to the non volatile memory!

Object 6003h: Preset value

This object indicates the preset value for the output position value. The encoder output position can be set to a desired value: Preset value. Set object 1010h from chapter 8 to save all parameters to the non volatile memory!

Subindex	Description	Data Type	Default Value	Access
0h	Preset Value	Unsigned 32	0h	rw

Object 6004h: Position value

This object contains the process value of the encoder.

Subindex	Description	Data Type	Default Value	Access
0h	Process Value	Unsigned 32	–	romap

Object 6500h: Operating status

This object shall provide the operating status of the encoder. It gives information on encoder internal programmed parameters.

Subindex	Description	Data Type	Default Value	Access
0h	Operating status	Unsigned 16	4	ro

Object 6501h: Single-turn resolution

The object contains the physical measuring steps per revolution of the absolute rotary encoder.

A value written in object 6001h must be lower than defined in 6501.

Subindex	Description	Data Type	Default Value	Access
0h	Single Turn Resolution	Unsigned 32	see type shield	ro

USER MANUAL
ABSOLUTE ROTARY ENCODER
ETHERCAT®

Object 6502h: Number of distinguishable revolutions

This object contains number of revolutions of the absolute rotary encoder.

A value written in object 6002h must be lower than defined as the multiplication of object 6501h and 6502h.

Object 6002h <= 6501h * 6502h.

Subindex	Description	Data Type	Default Value	Access
0h	Number of Revolutions	Unsigned 16	see type shield	ro

Object 6507h: Profile and software version

This object provides the implemented encoder device profile version and the manufacturer-specific software version.

Subindex	Description	Data Type	Default Value	Access
0h	Profile and Software Version	Unsigned 32	xxyy0302h	ro

The value is divided into the profile version part and the Software version part. Each part is divided in upper version and lower version.

MSB

LSB

Software Version xx.yy		Profile Version 3.2	
Upper Software Version	Lower Software Version	Upper Software Version	Lower Software Version
xx	yy	xx	yy

Object 6509h: Offset value

This object contains the offset value. It is been calculated by the preset function and shifts the physical position value with the desired value.

Subindex	Description	Data Type	Default Value	Access
0h	Offset value	Integer 32	-	ro

Object 650Bh: Serial number

This object contains the serial number of the device. The serial number is identical with the value in object 1018h subindex 4h.

Subindex	Description	Data Type	Default Value	Access
0h	Serial Number	Unsigned 32	See type sign	ro



USER MANUAL

ABSOLUTE ROTARY ENCODER

ETHERCAT®

10 Conformance Test

The screenshot displays the 'EtherCAT Conformance Test Tool' interface. The main window is titled 'Term 1 (P+F EtherCAT)'. It features a 'Project Explorer' on the left with a tree view of tests, including 'TF-1300_EtherCAT Slave Information T' and 'EtherCAT Devices'. The central area shows configuration fields for 'General Info', 'EEPROM', 'Memory', 'ESI', 'Mailbox', 'CoE Online', 'Startup', and 'Process Data'. The 'General Info' tab is active, showing fields for Name (EtherCAT), Product Code (0x4543), RevisionNo (0x10000), SerialNo (0x0000), Group (SSC_Device), and Id (0x000000ad). A status bar at the bottom indicates '169 Success', '0 Warnings', '0 Errors', '90 Skipped Cases', '725 Outputs', and '4238 Verbose'. Below the status bar is a log table with columns for Log No., Time Stamp, Test Case, and Info.

Log No.	Time Stamp	Test Case	Info
49	07/02/2013 04:49:32.620	SyncMan start addresses	No overlapping Sync Manager found
52	07/02/2013 04:49:32.714	SyncMan default size	No invalid Sync Manager sizes found
54	07/02/2013 04:49:32.714	SyncMan default usage	The Mailbox Sync Manager are used as recommended
56	07/02/2013 04:49:32.714	Secondary Vendor ID	Successful Valid Vendor ID in ESI file (0xad)
58	07/02/2013 04:49:32.730	Device.RevisionNo	Success ESI element Device.RevisionNo is used.
67	07/02/2013 04:49:32.730	ESI Port Type Consistency	Success Port configuration elements in ESI are valid.
69	07/02/2013 04:49:32.730	Number of Offline Dictionaries	Success ESI contains only one device profile.
73	07/02/2013 04:49:32.730	PDO Upload/Config/Assign	Success ESI elements are used in valid configuration.
76	07/02/2013 04:49:32.745	Vendor ID	Comparison of VendorID values succeeded



USER MANUAL
ABSOLUTE ROTARY ENCODER
ETHERCAT®

11 FAQ

1.) Question: After switching from "Free Run" to "Run" a comparison error appears (different VendorIDs)

Answer: Delete TwinCAT cache (xml file):

Windows XP:

C:\Documents and Settings\Username\Application Data\Beckhoff\TwinCAT\TwinCAT\lo

Windows 7:

C:\Users\Username\AppData\Roaming\Beckhoff\TwinCAT\TwinCAT\lo

2.) Question: TwinCAT don't find during "Scan Boxes"

Answers:

a.) Check if the network card is supported from TwinCAT

(http://infosys.beckhoff.com/english.php?content=content/1033/tcssystemmanager/reference/ethercat/html/ethercat_supnetworkcontroller.htm)

b.) During of the installation of TwinCAT under Windows 7 are admin rights necessary. User admin rights are not enough.

c.) Start TwinCAT with admin rights

d.) Install the driver for the network card.

3.) Question: I am using an Omron PLC, how can I setup the preset value?

Answer: There are two ways of setting the preset values.

a.) You can use the blocks as usual.

b.) On request we provide ESI files with Backup Flags.

When launching the project with this ESI file, the flag should appear on the main menu. You just have to perform the following steps:

- Transfer the preset value from the encoder to the PLC

- Change the preset value

- Transfer the preset value from the PLC to the encoder

USER MANUAL
ABSOLUTE ROTARY ENCODER
ETHERCAT®

12 Glossary

Terms	Description
10 Base T	Transmission line with 10 Mbit data transmission rate
100 Base T	Transmission line with 100 Mbit data transmission rate
APV	Absolute Position Value.
ASCII	American Standard Code for Information Interchange ASCII describes as code the correlation from digital integers to a normal font described character.
Batch file	Script program for MS-DOS
Baud rate	Transmission rate; it display the transmission bits per second
Binary	Numeric system with value 0 or 1.
Byte	8-bit unit of data = 1 byte.
CAN	Controller Area Network or CAN multiplexing network.
CANopen	Application layer of an industrial network based on the CAN bus.
CAT5	Terminations for transmission rates up to 100 Mbit.
CCW	Counter-clockwise
CiA	CAN In Automation, organization of manufacturers and users of devices that operate on the CAN bus.
CoE	CANopen over EtherCAT®
CRC	The cyclic redundancy check is a method from the information technology to control a checksum for data, to reduce errors by the transmission.
CW	Clockwise
DC	Distributed Clocks
EEPROM	Electrically Erasable Programmable Read-only Memory
EMC	Electromagnetic compatibility, there are rules to verifying devices.
ESC	EtherCAT® Slave Controller
ESI	EtherCAT® Slave Information, electronic data sheet based on XML
ETG	EtherCAT® Technology Group
EtherCAT®	EtherCAT® is registered trademark and patented technology, licensed by Beckhoff Automation GmbH, Germany
Ethernet	Ethernet is a computer network technology based on frames.
FAQ	Frequently Asked Questions
Fast Ethernet	Transmission technology with 100 Mbit transmission rate.
Flash	Internal memory, saved data will be available after power down.
IP-Protocol	The Internet Protocol is widespread in computer networks. It is the implementation of the internet layer of the TCP/IP-model
Mbit	Transmission rate or baud rate, million bits per second
OSI-Model	The Open System Interconnection reference model is an open layer model for the organization of a communication.
PCV	Process Value



USER MANUAL
ABSOLUTE ROTARY ENCODER
ETHERCAT®

PDO	Communication object, with a high priority for sending process data.
PLC	Programmable Logic Controller
PV	Preset Value: Configuration value
RO	Read Only: Parameter that is only accessible in read mode.
ROMAP	Read Only MAPable: Parameter that can be polled by the PDO.
RW	Read/Write: Parameter that can be accessed in read or write mode.
SDO	Communication object, with a low priority for messaging (configuration, error handling, diagnostics). Slave Bus node that sends data at the request of the master. The encoders are always slaves.
TCP	The Transmission Control Protocol is a connection orientated transmission protocol, in a network.
TwinCAT®	Configuration tool for Beckhoff controllers
WO	Write Only: Parameter that is only accessible in write mode.



USER MANUAL
ABSOLUTE ROTARY ENCODER
ETHERCAT®

13 Additional information

www.ethercat.org

ETG.1000, 2 ... 6: Layer protocol & service definitions

ETG.1020, EtherCAT Guidelines and Protocol Enhancements

ETG.1300, EtherCAT Indicator & Labeling specification (as per IEC 61784-2)

ETG.2000, EtherCAT Slave Information

ETG.2200, EtherCAT Slave Implementation Guide

CiA DS-301, CANopen communication profile

CiA DS-406, Profile Encoder for CANopen



USER MANUAL
ABSOLUTE ROTARY ENCODER
ETHERCAT®

14 History

Date	Description
2014-03-20	1 st release
2015-12-03	Added save command, communication profile, magnetically description and changed version to 1.2
2015-12-03	Added information about save command to object 6000-6003 Added object 1011 Changed object 1010 index 0 and document name to xCx-EC
2016-03-08	Updated section for firmware update
2019-01-09	Added a FAQ section

Disclaimer

FRABA N.V. all rights reserved. We do not assume responsibility for technical inaccuracies or omissions. Specifications are subject to change without notice.